



Verizon – Montauk, NY Project

Executive Summary

September 2022

Preface

We would like to share an executive summary for Verizon Data Center project in Montauk, Long Island NY.

By this document, we will present the data and the related findings of Hydromx[®]'s performance compared to glycol.

We would also like to share a brief information regarding Hydromx[®], its technology, the reports, certificates and the recent important developments.

For more details, please visit our website, www.hydromx.com or click [here](#) for our downloadable brochure.

Kind regards,

Hydromx[®] Team

Agenda

What is a Nanofluid?

Hydromx®

- How Hydromx® works?

Hydromx Reports and Certificates

- NSF - Toxicology
- EPD/LCA
- Corrosion Reports

Product Liability Insurance

Recent Developments

Global Projects

Verizon – Montauk Project

- System
- Drawings
- Results

Exhibits – Graphs & Sample Data

- – US Patent for Nanofluids
- Vertiv Glycol-Cooled Data for Upflow with Centrifugal (Forward-Curved) Fan(s), 60-Hz Models – 20 Tons Fan Motor kW

What is a Nanofluid?

A nanofluid is a fluid containing nanometer-sized particles, called nanoparticles. Such fluids are engineered colloidal suspensions of nanoparticles in a base fluid. The nanoparticles used in nanofluids are typically made of metals, oxides, carbides, or carbon nanotubes. Common base fluids include water, ethylene & propylene glycol, and oil

HOW SMALL IS A NANO?



Strand of Hair
~100,000 nanometers



Red Blood Cell
~10,000 nanometers



Bacteria
~1,000 nanometers



Average virus
~70–90 nanometers



COVID-19
~60–140 nanometers



Gold Atom
~0.33 nanometers

Hydromx[®]

[Hydromx[®]](#) is the first commercially viable and academically recognized, complete, non-toxic Efficient Heat Transfer Nanofluid in the World for hydronic closed-loop cooling and heating systems. Hydromx[®] is a Trade Secret Protected & Certified innovative nano-technology product that enables 20-35% energy savings of the associated HVAC bills with a guaranteed maximum of 3-year ROI and is also backed by a full product liability insurance.

Hydromx[®] is one of the top measures for buildings to improve energy efficiency, offer opportunities to create local jobs, save on energy bills, and cost-effectively reduce greenhouse gas emissions and other harmful pollutants.

How Hydromx[®] works?

Hydromx[®] leverages the nanoparticles to increase the speed and the effectiveness of the overall heat transfer process. As a result, the required target temperature is satisfied (necessary BTU delivered) in a shorter amount of time, thereby the system consumes significantly less energy versus the conventional Newtonian heat transfer mediums including water.

Hydromx[®] Reports and Certificates

Hydromx[®] has been tested throughout the world and awarded by many industry standard-setting certifications such as NSF International, ASTM, BuildCert, and NACE hence proving its compatibility with the latest building and environmental standards.



NSF NSF International/Nonfood Compounds Registration Program

Official Listing

NSF International Certifies that the products appearing on this Listing conform to the requirements of the NSF Nonfood Compounds Registration Program.

This is the Official Listing recorded on January 18, 2019.

Hydromx Inc.
58-75 57th Road
Maspeth, NY 11378
844-4HYDROMX
718-381-0351

Product Designation	Registration Number	Category Code
HYDROMX	151909	HT2
HYDROMX PG	156764	HT1

HT1 Heat transfer fluids with incidental contact.
HT2 Heat transfer fluids with no food contact.



CORROSION CERTIFICATION

System Protection
NSF APPROVAL FOR CHEMICAL INHIBITORS

NSF approval for nontoxicity is important. Also, Hydromx[®] is tested and approved by NSF for the closed loop system's health and durability. Not only do we care for the environment by reducing energy consumption, but we also provide the best protection formula for the machinery.

Certificate No: NSF2102/0219
Sample No: NSF2102

21st February 2019


Mr Berkin Airkan
Hydromx Inc
5875 57th Road
Maspeth
New York
11738
USA

Dear Mr Berkin

Samples of the chemical inhibitor described below have been subjected to relevant tests as detailed in the "NSF standard specification for the performance of Chemical Inhibitors for use in Domestic Hot Water Central Heating Systems", and verified as complying with the Scheme's requirements for marking, instructions of use and quality system. After considering the test reports and supporting documentation, the Technical Assessment Panel (TAP) of the Chemical Inhibitor Approval Scheme (CIAS) finds that the chemical inhibitor so described complies with the requirements of the above standard, and its use when correctly installed/commissioned satisfies the minimum requirements for chemical inhibitors specified in Part L of the Building Regulations (England & Wales), and the supporting Domestic building services compliance guide (2013 edition).

Toxicology

Nanotechnology is a known science and [nanofluids](#) have the capability and potential to revolutionize industries such as HVAC, automobiles, warm sea ships, plastic injection molding etc... [The United States has a patent](#) on nanofluids. In the Patent, it reads "Various nanofluids that may find widespread acceptance for industrial use should preferably be, as a minimum, stable Suspensions with little or no particle settling, available in large quantities at affordable cost, environmentally neutral, and **non-toxic**." Furthermore, there are thousands of research papers scientifically proving the fact that nanofluids do dramatically enhance the thermal transfer process.

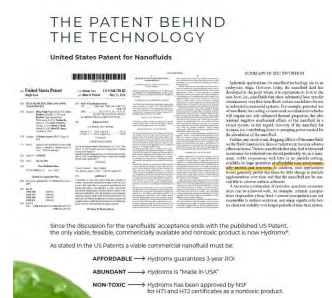

Picture 1 (Please see the Exhibit)

EPD / LCA

US Green Building Council (USGBC) Recognized

Hydromx®'s [Comparative LCA](#) and [EPD](#) are verified and certified by a panel put together by NSF, which is headed by Thomas P. Gloria, Ph.D., Director of Harvard University's Sustainability Department. NSF International certified and verified EPDs are type III environmental product declarations and will help new building or retrofit projects qualify for points through the Leadership in Energy and Environmental Design (LEED) [US Green Building Rating](#) System ([LEED V4](#)).

A Climate Declaration describes the emissions of greenhouse gases, expressed as carbon dioxide (CO₂) equivalents for a product's life cycle. This indicator is often referred to as "carbon footprint", which makes Hydromx® end-users automatically qualify to reduce their CO₂ emissions hence meeting the new stringent government requirements.



Corrosion Reports

Total System Protection

- **CORROSION PROTECTION**

Corrosion is a common problem that may cause your system to destroy zone valves, tanks, ball and check valves, etc.

- **SCALING PROTECTION**

Hydromx provides complete protection against scaling without decreasing the efficiency of your system.

- **FREEZING & BURST PROTECTION**

Glycol is the most common anti-freezing agent used in the industry.

- **BACTERIA PROTECTION**

Hydromx protects your system from the occurrence of pseudomonas and legionella bacteria.

[NSF Corrosion Report](#)

[NSF / Buildcert Corrosion Certificate](#)

[Nace-RP0775 \(Corrosion Station Performance\)](#)

[Corrosion Report – Holland](#)

Product Liability Insurance

Closed-loop systems are covered by a full product liability insurance against all damages that may arise from Hydromx. Hydromx has been renewing this insurance policy every year since 2013. No claims have been made so far.



The Cincinnati Specialty Underwriters Insurance Company

A Stock Insurance Company

Headquarters: 6200 S. Gilmore Road, Fairfield, OH 45014-5141
Mailing address: P.O. Box 145496, Cincinnati, OH 45250-5496
www.cinfin.com ■ 513-870-2000

COMMON POLICY DECLARATIONS

POLICY NUMBER: CSU0153445		PREVIOUS POLICY NUMBER: CSU0153445	
NAMED INSURED AND MAILING ADDRESS: Hydromx Inc Refer to Named Insured Schedule CSIA409 5875 57TH RD MASPETH NY 11378			
PRODUCER - Your contact for matters pertaining to this policy: 32-006 Marsh & McLennan Agency LLC 1400 EASTCHESTER DR STE 200 HIGH POINT NC 27265		Surplus Lines Broker: EX-1081092-R CSU Producer Resources, Inc. 6200 South Gilmore Road Fairfield, OH 45014-5141 Scott Hintze	
Policy Period: From 07/09/2022 To 07/09/2023 AT 12:01 A.M. STANDARD TIME AT YOUR MAILING ADDRESS SHOWN ABOVE.			
Form of Business: <input type="checkbox"/> Individual <input type="checkbox"/> Partnership <input checked="" type="checkbox"/> Corporation <input type="checkbox"/> Joint Venture <input type="checkbox"/> Limited Liability Company <input type="checkbox"/> Other			

Click [here](#) to download the Insurance Policy

Recent Developments

- Hydromx® had been installed in 20 different loops at The Empire State Building. Syska Hennessy specified Hydromx® for the Observatory renovation project at the Empire State Building.
- The Empire State Realty Trust has approved Hydromx® to be installed in the entire Chilled Water Loop of another iconic building at 1350 Broadway. Completed in December 2021.
- Skanska in the UK completed a case study in a heat recovery loop at London Royal Hospital in March 2021. Skanska has chosen Hydromx® to be installed 13 more major run-around loops in one of the largest London NHS Hospitals in the Fall of 2022 as the second step forward for a major launch throughout Skanska facilities.
- Xcel Energy, a grid company in Minnesota, issued our first rebate for their end-users that installed Hydromx® in their run-around loops; the rebate is 25% cash of the cost of the installation.
- CTC Case Study - Brainerd Public Utilities issued our second Rebate
- The manufacturing facility is completed at Queens Village in NY, making Hydromx® "Made in USA".

Hydromx comply with the NYC DOB

In 2020, the NYC Department of Buildings launched the Carbon Neutrality Innovation Challenge competition. The competition sought ideas for increasing energy efficiency and cutting emissions among NYC's buildings. Hydromx® won this competition for nanofluids. Following that NYC DOB announced a bulletin.

This Bulletin describes how heat transfer nanofluids, that comply with the description and acceptance criteria of this Bulletin, can be utilized in building mechanical systems in compliance with the NYC Construction Codes.

The Technical Bulletin dated October 1, 2021, NYC Department of Buildings (DOB) defined heat transfer nanofluids under the code MC 1207. In addition, regarding the toxicity limits, NYC DOB dictates that the nanofluids must acquire HT1 and HT2 NSF certification. NSF International's HT1 and HT2 categories are specifically designed by Food & Drug Administration and structured under FDA CFR 21.

Hydromx fulfils acceptance criteria, installation, and maintenance requirements for heat transfer nanofluids used in hydronic closed-loop HVAC systems by MC 1207.

[Bulletins](#)



BUILDINGS **2021-017** **BULLETIN** TECHNICAL

ISSUANCE DATE
October 1, 2021



ISSUER: Alan Price, P.E. 
Director, Office of Technical Certification and Research

PURPOSE: This document establishes acceptance criteria, installation, and maintenance requirements for heat transfer nanofluids used in hydronic closed-loop HVAC systems.

SUBJECT(S): Innovation Challenge, Heat Transfer Nanofluid, Hydronic Close-Loop HVAC System

RELATED CODE SECTIONS: AC 28-113, MC 1207

Proud Recognition from UK GREEN BUILDING COUNCIL

The UK Green Building Council is on a mission to “radically improve the sustainability of the built environment” across the United Kingdom. As a part of this mission, they call on members to submit sustainability challenges and invite the entire building industry to source solutions.


In January and February of 2022, they posed a challenge called “[Retrofitting Resilience](#)” with the question, “How can existing buildings be made more resilient to climate change, with as little disruption to their occupants as possible, by 2030?”

The UKGBC acknowledges that retrofitting existing buildings will play a huge role in limiting carbon emissions. They also stress the need to make buildings ready to handle the effects of climate change that will inevitably occur, regardless of what actions society takes in the near term.

Buildings in the future will have to deal with heat stress and more significant temperature variability, along with the increased cost and scarcity of heating fuel, making energy-saving solutions of paramount importance. Among the proposed solutions, the UKGBC judging panel highlighted a handful of technologies that best respond to this challenge, and [Hydromx was among them](#).

The UKGBC noted the product’s effectiveness “in a wide range of applications globally, including hospital space heating, commercial space heating and cooling, hospital cooling, heat recovery and space heating in social housing. Hydromx is a retrofit solution for existing systems with no modifications required.”

<https://www.ukgbc.org/solutions/hydromx/>

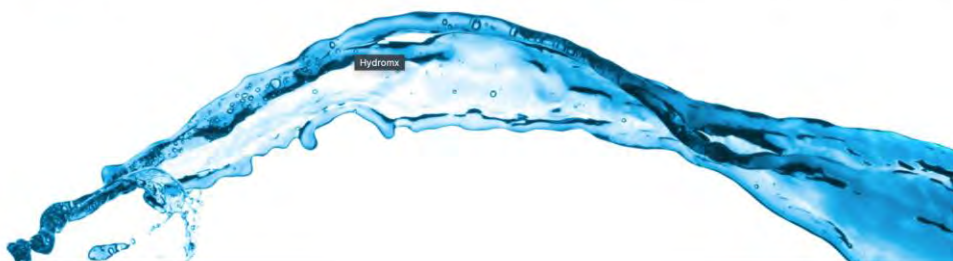[ABOUT](#) ▾[MEMBERSHIP](#) ▾[OUR WORK](#) ▾[SOLUTIONS](#) ▾[COURSES & EVENTS](#)[NEWS & OPINION](#)[CONTACT US](#)**HYDROMX**

NYC Accelerator Accepted Hydromx as a Service Provider to Fight CO² Emission in New York City

In 2012, New York City launched the NYC Accelerator program. The mayor's office of climate and sustainability is working with building owners across its five boroughs to lower carbon emissions. Their goal is to make New York City carbon-neutral by 2050, and buildings account for 68% of the city's carbon emissions.

The experts at NYC Accelerator have outlined several strategies to retrofit older buildings (and equip new construction) with green technologies. They offer building owners a free energy summary report to identify opportunities for energy conservation.

Hydromx, the revolutionary heat-transfer nanofluid, has been shown to increase the efficiency of closed-loop heating and cooling systems by up to 40%. It has a proven track record of decreasing energy consumption and greenhouse gas emissions for many kinds of buildings, from offices and schools to healthcare facilities and data centers. Hydromx guarantees a maximum return on investment of three years — and several case studies point to even faster recuperation of costs.

Hydromx has aligned its goals as a company with those set forth by COP26, the recent UN Climate Change Conference, and offers clients the least-intrusive way to upgrade existing heating and cooling systems to meet those goals.

<https://www.hydromx.com/nyc-accelerator-award-hydromx/>



**Hydromx is an official service
provider for the NYC
Accelerator program.**

Global Projects

1350 Broadway	Liben Electricity Production Plant
Ajit Bahawan	Luna Fluid Tech
BAS Surgical	Madison School
Blue Star Chiller Manufacturer	Mahindra Tractors
BPS Electricity Production Plant	MBA Engineering
Camp Ripley	Mechanical and Chemical Industries Association
Carrefour Shopping Mall	Microlab
Cass County Data Center	Minneapolis-St. Paul Airport (MSP)
CIPET	Montana State University
Club Mahindra Hotel	Nestle Chocolate Factory
CNC Stone	Northwestern College
Colonial Church	Radion Building
CTC Data Center	RedFox Hotel
Cuyuna Regional Medical Center	Residential Care Home
Dubai Ice Arena	Ridgeview Medical Center
Empire State Building	Royal Bank of Scotland
Equinix Atlanta Site	Royal Orthopedic Hospital
Erzurum Air Base	Samsung Electronics
Forest Green Rovers Football Club	SL Green
General Directorate of Mining Affairs	Student Accommodation
Hamworthy Boiler Manufacturer	Sujan Rajmahal Palace
Hayat Kimya	SV Development
HBO Data Center	Temple Israel
Hennepin County Forensic Science	The Roseate
Holiday Inn	Tierpoint Data Center
Honda Motorcycle Factory	University of North Dakota
Hotkovic	University of St. Thomas
ITC Maurya	Virginia Tech University Data Center
Jezenice Electricity Production Plant	Voets & Donkers
Lalit Hotel	



The Verizon logo is displayed in a large, bold, black sans-serif font. The word "verizon" is in lowercase, and a red checkmark is positioned to the right of the "n". The background of the slide features a light gray, low-poly geometric pattern.

Montauk // New York

Verizon – Montauk, NY Project

System

Verizon Data Center Montauk, Long Island, NY

Two identical Vertiv DS series, CRAC units with model no DSVS070KD.

Water cooled compressors, by dry coolers with model no DDO498Y64 Quiet line.

SCADA system to record the KPI

1. T_{air} Supply to Server room

2. T_{air} Return from Server room


3. T_{fluid} supply to Condenser

4. T_{fluid} return from Condenser

5. $T_{outdoor}$ at Dry coolers

6. Kw of CRAC

7. Kwh of CRAC

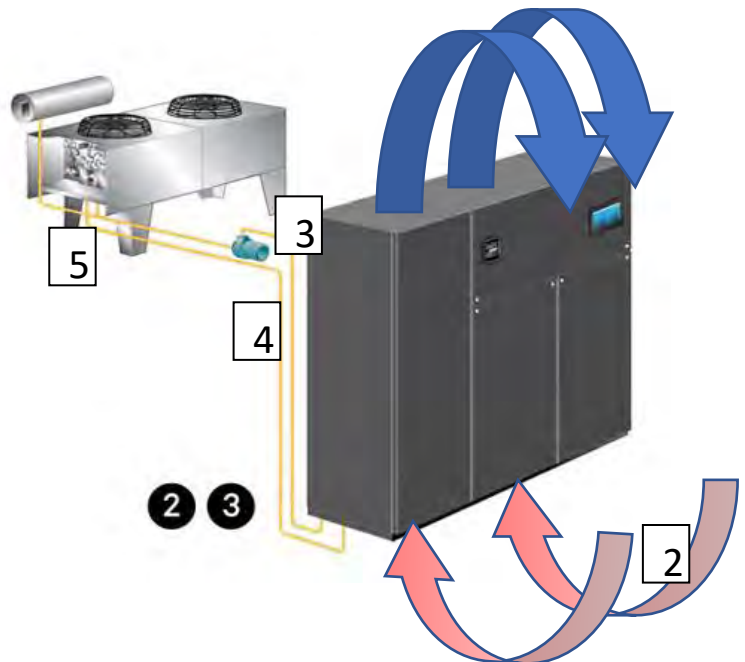


Identical two units are both brand new installation. Identical set points: 74 Return Air and 50 rh.

The only difference is the cooling liquid that circulates in between condenser & dry coolers.

One unit runs with glycol-water mixture 35%, the other one runs with Hydromx-water mixture at 44%. The independent CRAC units are run alternately per week. The kWh values are compared for the weeks that they are active.

The data and results shared in this summary are based on the raw data that has been recorded by the SCADA software, which is available for online connection upon request.

Drawing

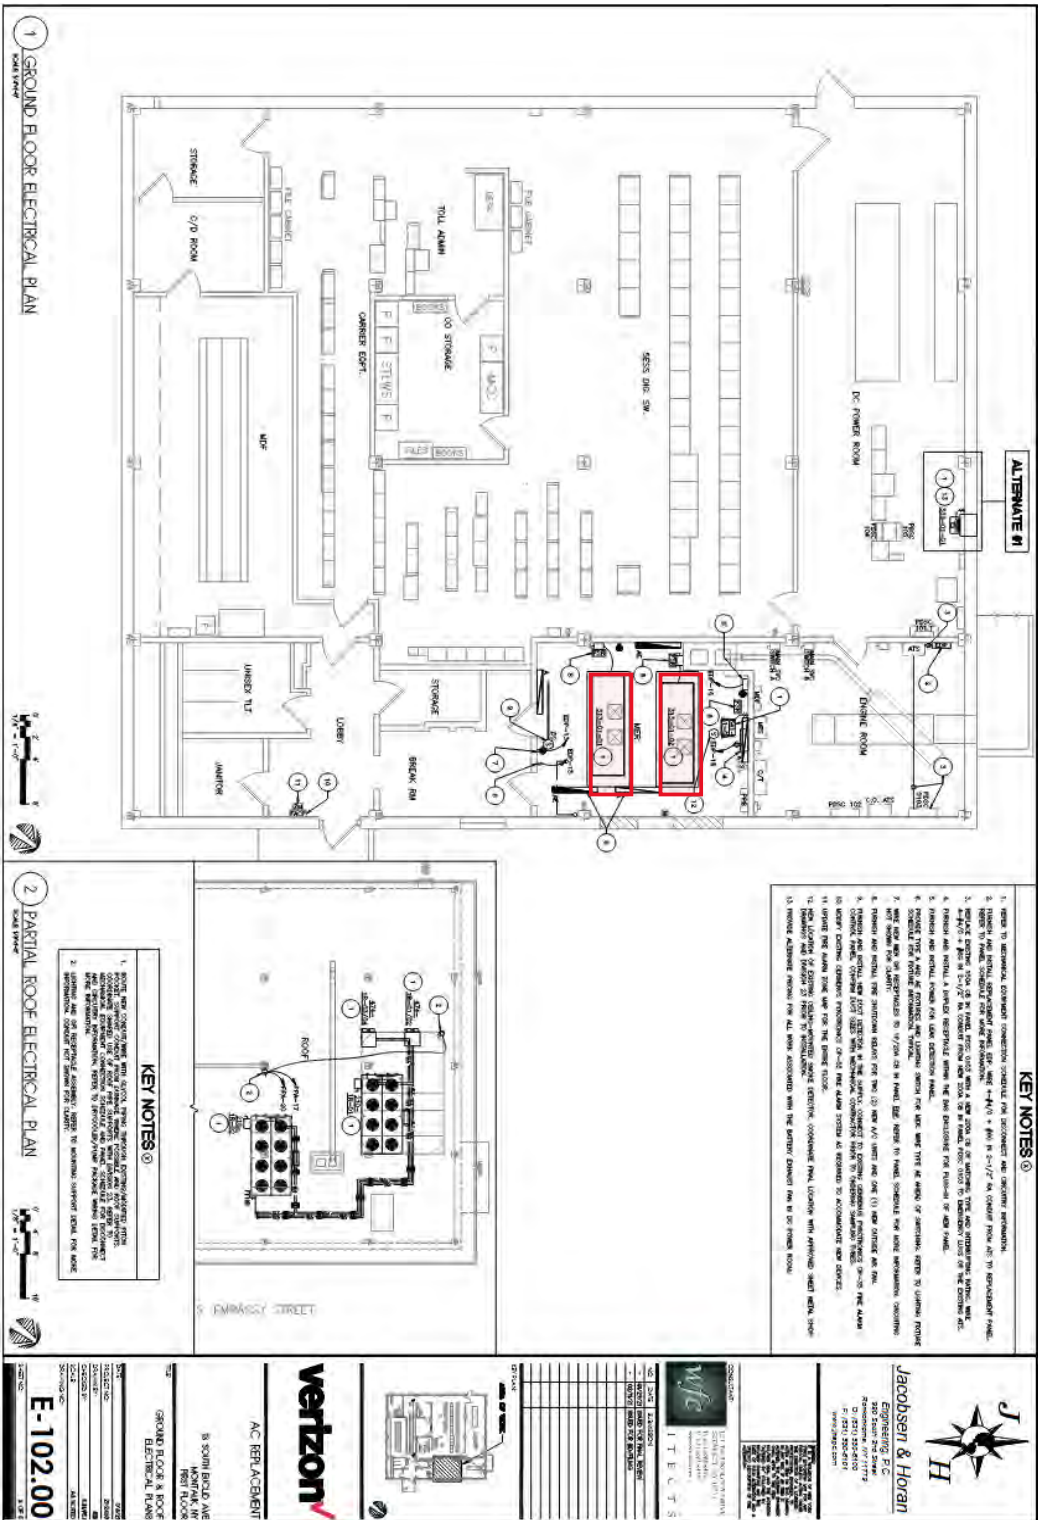

Results:

For the period from July14th to September 13th, the kW data collected from the SCADA system. *(Please see a sample of the data at the Exhibit. Full dataset can be downloaded from the Cloud).*

The hourly averages of Total kW consumptions of the Vertiv Units along with total kWh Data have continuously been recorded along with other pertinent data points. Units have been alternating on a weekly basis.

Furthermore, the outside temperatures are downloaded from wunderground.com for Montauk and included into the spreadsheet. As seen below, for different temperature ranges, Hydromx[®] performs significantly better compared to glycol. The higher OAT temperatures allow Hydromx[®]’s performance to get better, due to increased load in the space. Higher load demand in the building is directly correlated to the outside temperature increases. Since Hydromx[®] saves on the compressor kWh, higher loads unequivocally impact Hydromx’s performance.

The identical Vertiv Units at the site have continuously been running single stage a Fan Motor, which draws 3.7 kW. In order to quantify the percentage impact of Hydromx on the compressor consumption, hence, to be able to determine the precise efficiency, Fan Motor’s consumption must be adjusted. (please see the final Exhibit’s highlighted areas)


Below tables show both Glycol and Hydromx Units’ kWh consumptions broken down by 5 F OAT incremental:

UNITS’ TOTAL kWh - OUTSIDE AIR TEMPERATURE RANGES

OAT	GLYCOL (avg kWh)	HYDROMX (avg kWh)	Efficiency %
60 t0 65 °F	15.82	13.93	11.98%
66 to 70 °F	16.51	14.28	13.50%
71 to 75 °F	17.90	14.73	17.70%
76 to 80 °F	18.81	15.29	18.73%
81 to 85 °F	19.18	15.58	18.79%
+ 86 °F	21.08	15.70	25.50%
OVERALL OAT AVG	74.42 F	74.56 F	For the period
FAN MOTOR KWH	3.70	ADJUSTED	

OAT	GLYCOL (avg kWh)	HYDROMX (avg kWh)	Efficiency %
60 t0 65 °F	12.12	10.23	15.64%
66 to 70 °F	12.81	10.58	17.40%
71 to 75 °F	14.20	11.03	22.32%
76 to 80 °F	15.11	11.59	23.32%
81 to 85 °F	15.48	11.88	23.28%
+ 86 °F	17.38	12.00	30.93%

Total kWh Avg of both Units vs OAT

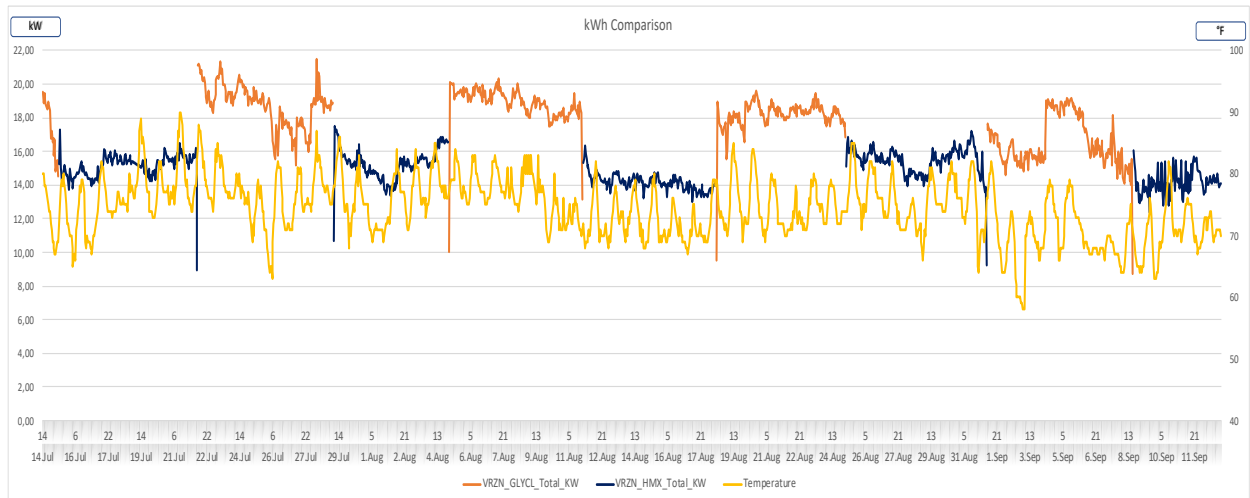

Total kWh Comparison & Expected ROI Analyses

The SCADA energy analyzer recorded all 3 phases from both Units to calculate the Total kWh, which was a requirement of the Verizon Sustainability Team. On July 31st, there was a 23 hours of “hourly” missing data, yet total kWh data continued to record.. Therefore, a missing total number of hours had to be added.

If the both Units would run about **4 months** on Montauk, the ROI calculation would be as follows. Clearly, we cannot quantify the Glycol pump efficiency due to longer hours of free cooling. To clarify, the Fan Motor adjustment is not part of this ROI analysis. Below analysis is based solely on kWh savings resulted from Hydromx.

And the reason that the starting kWh’s are different is due to the PLC’s previous recorded data, which has no impact on the data except a starting point difference.


TOTAL kWh of the Units	GLYCOL (total kWh)	HYDROMX (total kWh)	
14.07.2022	10761.03	5881.68	
13.09.2022	23,105.36	17,758.21	
Total kWh Consumption	12,344.33	11,876.53	
Total Hours	675	781	
Due to missing data on Jul31st	12,210.75	11,566.61	kWh Difference
Average Consumption/Hr	18.09	14.81	3.3
HMX Performance	22.1%		
If both Units had Hydromx			
Summer kWh rate (Avg)	19 cents		
Expected Savings (4 months)	\$1,794.82		
Hydromx Installed (gal) x 2	240		
Hydromx Cost / gal	\$40.00		
ROI (months)	20	Excluding pump efficiency	

Supporting Findings:


One may rightfully wonder the effects of an efficient heat transfer nanofluid on the operating temperatures which in return would lead to significant savings.

During the Hydromx period “Evaporator Supply Air temp” was 67°F whereas it was 71°F at the glycol period. If the system should have been configured to have the same supply temps, Hydromx period could have saved significantly more.

Vertiv technical team agreed on the fact due to complex algorithms on the Units, a 74F setpoint do not necessarily mean that the space will run at 74F sharp.

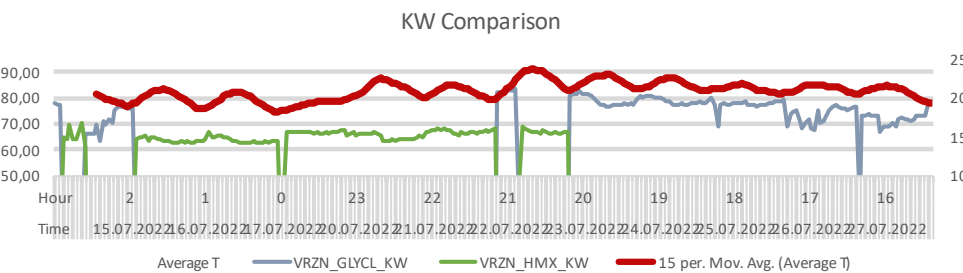


Graph 1

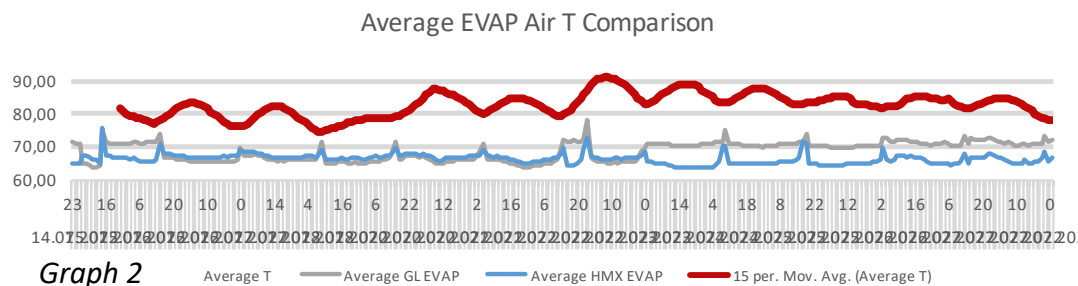

Graph 2

The operating fluid temps have been reflecting the same. Hydromx’s average fluid temp is 84°F, whereas it is 90°F at glycol for the period.

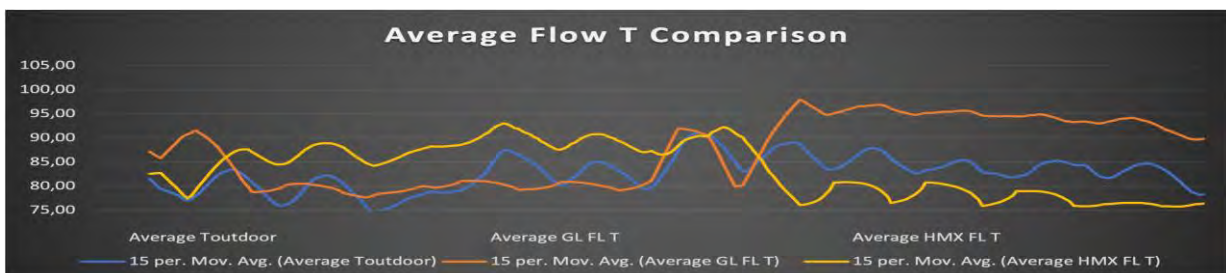


Graph 3

Please see the Exhibit for the full scale graphs


Exhibits

KW Comparison

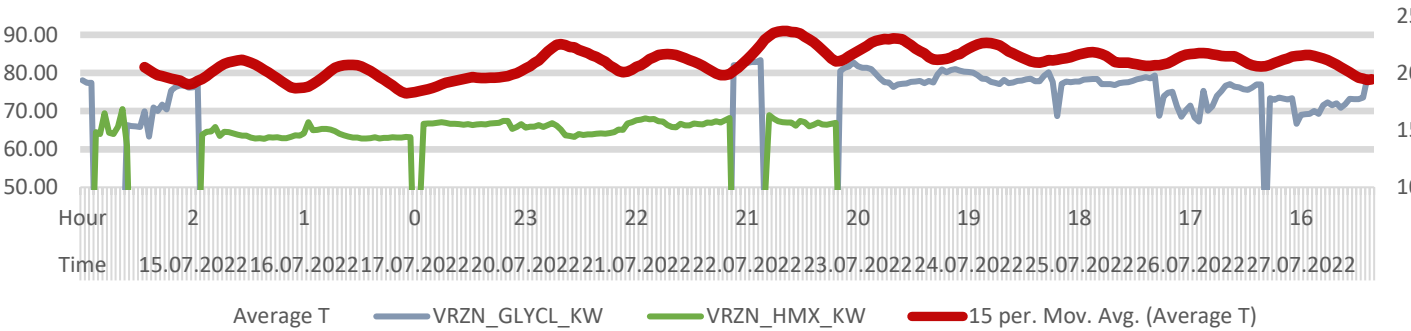


Graph 1

Average EVAP Air T Comparison

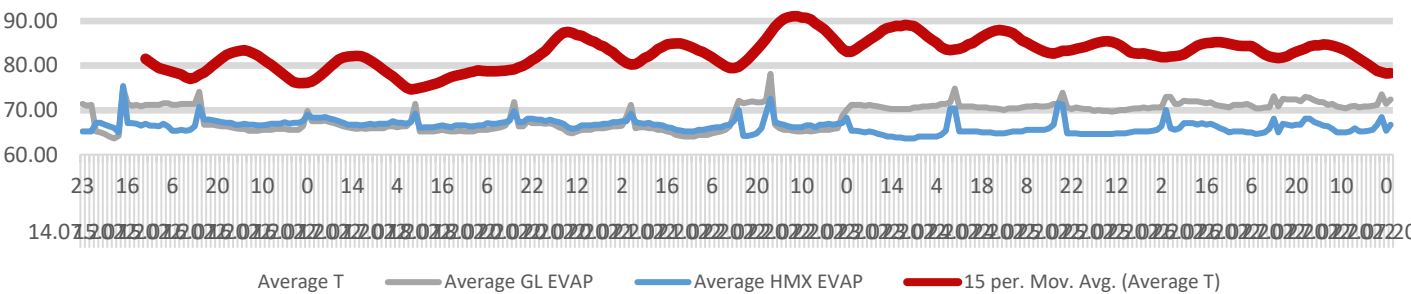

Graph 2

Average Flow T Comparison

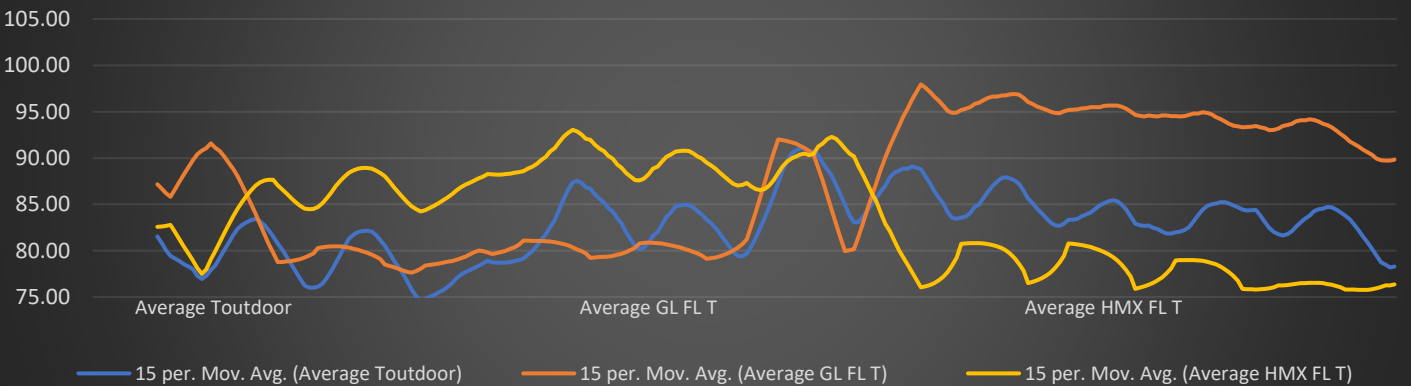

Graph 3

Exhibits – (continued)

Exhibits — *(continued)*

Sample Data Spreadsheet

Date	Hour	Time EST	Time TR	Glyd/HMX	VRZN_GLYCL_Total_KW	VRZN_HMX_Total_KW	Temperature	VRZN_GLYCL_Total_kwh	VRZN_HMX_Total_kwh
14 Jul	14	14:00:00	21:00:00	GLYCL	19,56		80	10.761,03	5.881,68
14 Jul	15	15:00:00	22:00:00	GLYCL	18,89		80	10.780,11	5.881,82
14 Jul	16	16:00:00	23:00:00	GLYCL	19,45		78	10.799,49	5.881,98
14 Jul	17	17:00:00	00:00:00	GLYCL	19,23		78	10.818,58	5.882,12
14 Jul	18	18:00:00	01:00:00	GLYCL	18,80		78	10.837,38	5.882,27
14 Jul	19	19:00:00	02:00:00	GLYCL	18,69		77	10.856,07	5.882,42
14 Jul	20	20:00:00	03:00:00	GLYCL	18,51		76	10.874,94	5.882,56
14 Jul	21	21:00:00	04:00:00	GLYCL	18,96		75	10.893,91	5.882,72
14 Jul	22	22:00:00	05:00:00	GLYCL	18,70		74	10.912,69	5.882,87
14 Jul	23	23:00:00	06:00:00	GLYCL	18,46		74	10.931,19	5.883,01
15 Jul	0	00:00:00	07:00:00	GLYCL	16,76		72	10.947,88	5.883,17
15 Jul	1	01:00:00	08:00:00	GLYCL	17,19		71	10.965,17	5.883,31
15 Jul	2	02:00:00	09:00:00	GLYCL	16,59		69	10.981,81	5.883,46
15 Jul	3	03:00:00	10:00:00	GLYCL	16,77		69	10.998,89	5.883,61
15 Jul	4	04:00:00	11:00:00	GLYCL	15,80		68	11.014,54	5.883,76
15 Jul	5	05:00:00	12:00:00	GLYCL	16,67		67	11.031,17	5.883,91
15 Jul	6	06:00:00	13:00:00	GLYCL	14,81		67	11.046,49	5.884,06
15 Jul	7	07:00:00	14:00:00	GLYCL	15,21		68	11.061,81	5.884,20
15 Jul	8	08:00:00	15:00:00	GLYCL	15,49		69	11.077,19	5.884,35
15 Jul	9	09:00:00	16:00:00	GLYCL	14,52		69	11.091,96	5.884,61
15 Jul	10	10:00:00	17:00:00	HMX		15,25	72	11.092,13	5.900,09
15 Jul	11	11:00:00	18:00:00	HMX		17,27	75	11.092,30	5.916,98
15 Jul	12	12:00:00	19:00:00	HMX		15,06	78	11.092,47	5.932,00
15 Jul	13	13:00:00	20:00:00	HMX		14,31	79	11.092,64	5.946,70
15 Jul	14	14:00:00	21:00:00	HMX		14,39	78	11.092,81	5.961,47
15 Jul	15	15:00:00	22:00:00	HMX		14,78	80	11.092,97	5.976,25
15 Jul	16	16:00:00	23:00:00	HMX		14,81	79	11.093,14	5.990,93
15 Jul	17	17:00:00	00:00:00	HMX		15,19	78	11.093,31	6.005,77
15 Jul	18	18:00:00	01:00:00	HMX		14,89	77	11.093,48	6.020,49
15 Jul	19	19:00:00	02:00:00	HMX		14,57	75	11.093,65	6.035,02
15 Jul	20	20:00:00	03:00:00	HMX		14,58	72	11.093,82	6.049,57
15 Jul	21	21:00:00	04:00:00	HMX		14,28	72	11.093,99	6.063,98
15 Jul	22	22:00:00	05:00:00	HMX		13,72	71	11.094,17	6.078,28
15 Jul	23	23:00:00	06:00:00	HMX		14,95	70	11.094,34	6.092,57
16 Jul	0	00:00:00	07:00:00	HMX		14,54	70	11.094,51	6.106,94
16 Jul	1	01:00:00	08:00:00	HMX		14,24	70	11.094,68	6.121,29
16 Jul	2	02:00:00	09:00:00	HMX		14,35	68	11.094,85	6.135,67
16 Jul	3	03:00:00	10:00:00	HMX		13,84	65	11.095,02	6.149,93
16 Jul	4	04:00:00	11:00:00	HMX		14,40	66	11.095,19	6.164,23
16 Jul	5	05:00:00	12:00:00	HMX		14,45	67	11.095,36	6.178,51
16 Jul	6	06:00:00	13:00:00	HMX		14,44	66	11.095,53	6.192,86

Exhibits — (continued)

20 Tons

Model Size - Upflow Configuration		VS035	VS042	VS053	VS070	VS077	VS105
R22 Evaporator - Net Capacity Data with 104°F Entering and 11.5°F Leaving 50% Propylene Glycol Temperatures							
Compressor Type		Digital Scroll				Semi-Hermetic (Four-Step Cooling)	
85°F DB ¹ , 64.4°F WB, 52°F DP, 32% RH (29.4°C DB, 18°C WB)	Total, kW (BTUH)	57.6 (128,000)	42.2 (544,000)	59.5 (205,000)	77.1 (249,000)	76.9 (262,000)	95.1 (322,000)
	Sensible, kW (BTUH)	37.6 (128,000)	42.2 (144,000)	59.5 (203,000)	70.7 (241,000)	76.7 (262,000)	94.3 (322,000)
	Flow Rate, GPM (lps)	86.1 (2.8)	40.8 (2.6)	52.8 (3.2)	66.6 (4.1)	72.2 (4.5)	89.6 (5.6)
	Unit Pressure Drop, ft of Water (kPa)	16.6 (49.6)	20.8 (62.2)	18.8 (56.2)	28.4 (84.9)	33.9 (101.4)	45.3 (135.4)
	Heat Rejection, kW (BTUH)	58.9 (184,000)	61.0 (208,000)	75.8 (259,000)	97.9 (334,000)	107.6 (357,000)	132.7 (456,000)
	External Static Pressure, in.w.g. (Pa)	0.4 ¹ (100)	0.4 ¹ (100)	0.4 ¹ (100)	0.5 ¹ (125)	0.5 ¹ (125)	0.5 ¹ (125)
80°F DB ¹ , 62.7°F WB, 52°F DP, 33% RH (25.7°C DB, 17.1°C WB)	Total, kW (BTUH)	55.0 (119,000)	39.2 (134,000)	54.5 (186,000)	64.9 (221,000)	77.3 (240,000)	86.8 (296,000)
	Sensible, kW (BTUH)	35.0 (119,000)	39.2 (134,000)	54.5 (186,000)	64.9 (221,000)	77.3 (240,000)	86.8 (296,000)
	Flow Rate, GPM (lps)	84.8 (2.2)	39.5 (2.4)	50.8 (3.2)	66.5 (4.1)	69.1 (4.4)	87.7 (5.4)
	Unit Pressure Drop, ft of Water (kPa)	14.9 (44.6)	18.9 (56.5)	17.3 (51.7)	26.4 (78.9)	31.2 (93.3)	41.6 (124.4)
	Heat Rejection, kW (BTUH)	51.1 (174,000)	57.9 (198,000)	75.5 (240,000)	94.2 (321,000)	109.1 (362,000)	127.9 (426,000)
	External Static Pressure, in.w.g. (Pa)	0.5 (125)	0.5 (125)	0.5 (125)	0.5 (125)	0.5 (125)	0.5 (125)
75°F DB ¹ , 61°F WB, 52°F DP, 44% RH (23.9°C DB, 16.1°C WB)	Total, kW (BTUH)	52.6 (111,000)	36.1 (120,000)	52.1 (174,000)	63.8 (216,000)	69.0 (232,000) ^{2a}	84.0 (287,000) ^{2a}
	Sensible, kW (BTUH)	31.3 (107,000)	35.3 (120,000)	47.9 (163,000)	56.9 (194,000)	59.0 (201,000) ^{2a}	75.1 (256,000) ^{2a}
	Flow Rate, GPM (lps)	82.6 (2.1)	37.0 (2.3)	48.6 (3.1)	60.0 (3.8)	65.0 (4.1) ^{2a}	80.2 (5.1) ^{2a}
	Unit Pressure Drop, ft of Water (kPa)	13.6 (40.7)	17.2 (51.4)	16.1 (48.1)	24.7 (73.9)	28.0 (83.7) ^{2a}	38.0 (113.6) ^{2a}
	Heat Rejection, kW (BTUH)	48.7 (166,000)	55.2 (189,000)	73.6 (246,000)	90.0 (311,000)	97.0 (331,000) ^{2a}	125.1 (423,000) ^{2a}
	External Static Pressure, in.w.g. (Pa)	1.0 ² (250)	1.0 ² (250)	1.0 ² (250)	1.0 ² (250)	1.0 ² (250)	1.0 ² (250)
Compressor Type		Scroll (Two-Step Cooling)					
85°F DB ¹ , 64.4°F WB, 52°F DP, 32% RH (29.4°C DB, 18°C WB)	Total, kW (BTUH)	36.5 (125,000)	42.4 (145,000)	60.1 (205,000)	72.9 (249,000)		
	Sensible, kW (BTUH)	36.5 (125,000)	42.4 (145,000)	60.0 (205,000)	72.1 (246,000)		
	Flow Rate, GPM (lps)	34.4 (2.2)	40.1 (2.5)	53.2 (3.4)	66.7 (4.2)		
	Unit Pressure Drop, ft of Water (kPa)	15.0 (44.3)	20.1 (60.5)	19.5 (57.1)	23.4 (67.3)		
	Heat Rejection, kW (BTUH)	51.3 (175,000)	59.9 (204,000)	79.5 (271,000)	99.5 (340,000)		
	External Static Pressure, in.w.g. (Pa)	0.4 ¹ (100)	0.4 ¹ (100)	0.4 ¹ (100)	0.5 ¹ (125)		
80°F DB ¹ , 62.7°F WB, 52°F DP, 38% RH (26.7°C DB, 17.1°C WB)	Total, kW (BTUH)	33.9 (116,000)	39.4 (134,000)	56.7 (193,000)	69.4 (237,000)		
	Sensible, kW (BTUH)	33.9 (116,000)	39.4 (134,000)	56.1 (190,000)	68.1 (233,000)		
	Flow Rate, GPM (lps)	32.7 (2.1)	38.2 (2.4)	51.2 (3.2)	64.4 (4.1)		
	Unit Pressure Drop, ft of Water (kPa)	13.6 (40.7)	18.2 (54.7)	17.7 (52.9)	27.4 (81.3)		
	Heat Rejection, kW (BTUH)	48.8 (167,000)	57.1 (195,000)	76.4 (261,000)	96.1 (328,000)		
	External Static Pressure, in.w.g. (Pa)	0.5 (125)	0.5 (125)	0.5 (125)	0.5 (125)		
75°F DB ¹ , 60.1°F WB, 52°F DP, 44% RH (23.9°C DB, 16.1°C WB)	Total, kW (BTUH)	31.1 (106,000)	36.7 (125,000) ^{2a}	53.1 (181,000)	65.5 (223,000)		
	Sensible, kW (BTUH)	30.6 (104,000)	36.4 (122,000) ^{2a}	49.5 (167,000)	60.0 (206,000)		
	Flow Rate, GPM (lps)	31.1 (2.0)	35.9 (2.3) ^{2a}	49.4 (3.1)	62.4 (3.9)		
	Unit Pressure Drop, ft of Water (kPa)	12.4 (37.1)	16.6 (47.8) ^{2a}	16.6 (47.8)	25.8 (77.1)		
	Heat Rejection, kW (BTUH)	46.4 (158,000)	53.6 (183,000) ^{2a}	73.7 (251,000)	93.0 (317,000)		
	External Static Pressure, in.w.g. (Pa)	1.0 ² (250)	1.0 ² (250)	1.0 ² (250)	1.0 ² (250)		

FAN SECTION - Centrifugal (Forward-Curved)

Room Air Volume - ACFM (ACFM)	VS035	VS042	VS053	VS070	VS077	VS105
Standard Fan Motor, hp (kW)	3.0 (2.2)	5.0 (3.7)	3.0 (2.2)	5.0 (3.7)	7.5 (5.6)	10.0 (7.5)
Optional Fan Motor, hp (kW)	5.0 (3.7)	7.5 (5.6)	5.0 (3.7)	7.5 (5.6)	10.0 (7.5)	15.0 (11.2)
Number of Fans	1	1	2	2	2	3

1. Based in accordance with the AHRI Reduced Cooling Certification Program to AHRI Standard 135B (1-F) Standard Rating Conditions.
2. Certified in accordance with the ASHRAE Standard 155-2015 Standard Rating Conditions. Certified units may be found in the Compliance Certification Database at www.rspg.com/ahri.
3a. Performance data derived from Room ACFM required to be listed in Compliance Certification Database. (VS035-4,500; VS077-4,500; VS105-12,500)
b. Some options or combinations of options may result in reduced airflow. Consult factory for recommendations.
c. Net capacity data has fan motor heat factored in for all ratings.
d. Consult factory for fan unit performance options. Performance data generated in LBS Update Version 02-15-2019.
e. See Table 2.15 for Optional Fan Coil Performance.